




NFPA 1410 Evolutions

Standard on Training for Initial Fire Attack

NFPA 4—Offensive Single Engine: Handline—Wyeed Line Attack

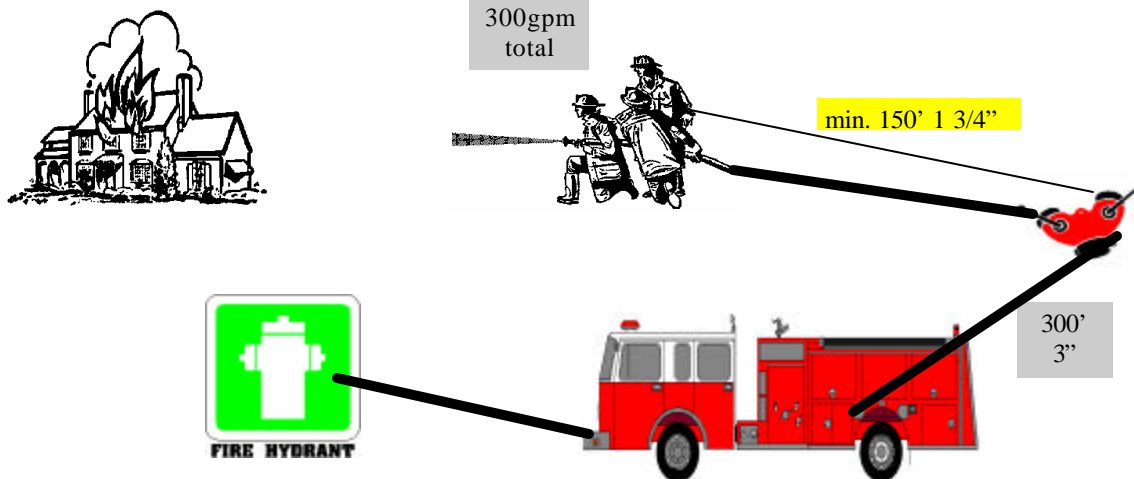

Objective: Using a 2 1/2" gated wye appliance, place a initial attack line (1 3/4") of min. 150' and back-up line (2 1/2") of min. 150' in-service using units and staffing of the average number of personnel that ordinarily respond.

Evolution Description:

A fire attack scenario utilizing a reverse lead out with a (skid load) wye appliance and 2 hoselines of a minimum of 150' each capable of a total flow of 300gpm within 4 minutes from start of evolution. Engine shall be permitted to charge the initial attack line with tank water, hydrant supply shall be established **before** back-up line is in place. A 300' supply line to the wye appliance of minimum 2 1/2" shall be used. Hydrant suction hose shall be used between engine and the hydrant.

Evaluation Criteria:

- All lines shall be completely deployed from hosebeds.
- All nozzles shall be flowing minimal acceptable pressures. Solid tips; 50psi Combo tips; 100 psi
- Time begins at signal from training officer until water is flowing at required pressure from both lines and supply line has been established.

Recommended Maximum time: 4 minutes

Reference: NFPA 1410, 2000 Edition; Training for Initial Emergency Scene Operations
Department SOG's

NOTE: Instructors/Officers should substitute their department standard hose sizes, manpower, and procedures for this evolution. This evolution is provided as a guide to help you set-up an initial attack evolution. Please review NFPA 1410, 2000 edition for a complete breakdown of these evolutions.